

Pyrotenax slab heating cable installation guide

Materials required

1. Netting clips and C-Clip Pliers
2. Tape Measure
3. Insulation Tester 500Volt
4. Flexible conduit (supplied)
5. Wire or tape (fix flexible conduit to mesh)

Step 1. Inspect the site to ensure that the concrete reinforcing mesh has been laid out and supported as per the builder's plan and your own floor plan. Any deviation or modification with regard to the slab heater layout should be taken into account at this time.	Step 2. Mark the walls and built in joinery on the plastic membrane before laying out the cable.	Step 3. The slab heater should be tested with a 500V insulation tester, for insulation and continuity, prior to cable laying. The heater should have an infinity insulation value.	Step 4. Determine the starting point(s) on the plan ensuring both cold tails return to this point, allowing for the cold tail connection(s).
Step 5 Lay the cable in accordance with the required spacing. See below how to calculate spacing. It is recommended that the cable be clipped to the mesh at 400-500mm intervals.	Step 6. The conduit should be slid over the cold tails when they are in position then wire or tape securely to the mesh.		

Cable spacing instructions

Cable spacing is determined by the available floor area and slab heater length and can vary from 150mm to 250mm. A simple formula is used to calculate the correct spacing of the elements to cover the area involved.

Cable spacing formula

$$\frac{\text{heated floor area m}^2 \times 1000}{\text{element length (m)}}$$

Note: Heated floor area delete the distance cables start from walls. eg: 200mm each end.

Example: Room size = 5.2m X 6.2m
= 32.24m²


Select 6kW heating element 137m

$$\frac{\text{SP} = \text{A} \times 1000}{\text{L}}$$

$$\frac{4.8 \times 5.8 \times 1000}{137}$$


= 200mm spacing

Pyrotenax slab heating cable installation guide

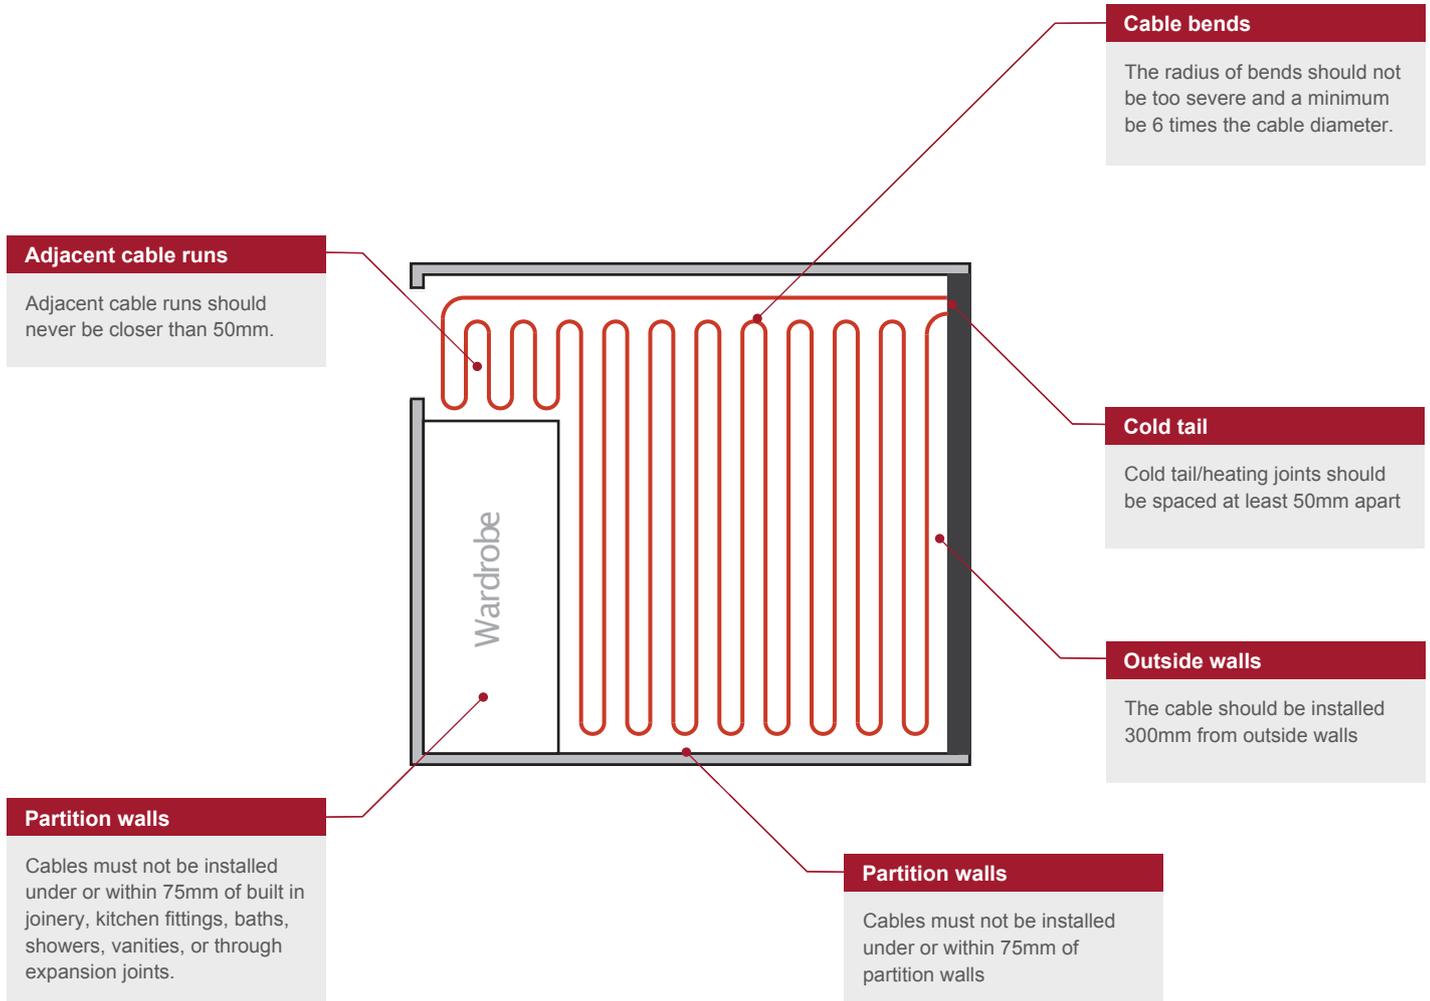

Attention

- The heating cable runs should not touch or cross, or be closer than 50mm, and must not be in direct contact with any insulation material.
- Cables must not be installed through any expansion joints or construction joints (unless special design considerations for the cable have been made).
- All electrical work must be performed by an authorised electrician.

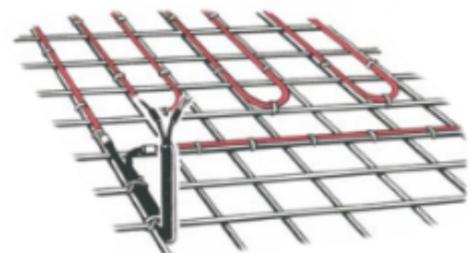

(Above) If the mesh grid size is not compatible with the required spacing, an approximation of the cable runs is required - as near as possible to the calculated spacing.

Pyrotenax slab heating cable installation guide

Concreting Procedure

1. Before concreting commences the slab heater(s) should be tested again with a 500V insulation tester and an infinity reading obtained.

2. It is essential that an insulation tester be used to continually monitor the element during the concreting. If required an insulation tester with an audible alarm is available from Pyrotenax.

3. Should a fault be indicated at any time during the concrete pour then the pour should be temporarily halted, the fault located and cleared of concrete, and a small area of approximately 600mm x 300mm boxed off deep enough to expose the cable and allow the concreting operation to continue. The repair can be made later.

4. If possible, runways and working platforms should be arranged, and supported clear of the mesh surface. This is to reduce the amount of foot traffic on the cable and prevent the wheeling and direct tipping of wheelbarrows, which would damage the cable.

5. The use of pumped concrete can reduce the possibility of damage to the cables.

6. Rubber boots should be worn to avoid the possibility of damage by steel tipped boots.

7. It is essential that **the heating cable is covered by a minimum of 25mm of concrete** and positioned not lower than midway in the slab, also that the cold tail/heating element joint is completely buried in the concrete.

8. It is essential to ensure that the concrete is cured naturally to avoid shrinking, and cracks developing at a later date.

9. After concreting is completed the slab heaters should again be tested.